


ACME-SHOREY

PRECAST CONCRETE PRODUCTS


WWW.ACME-SHOREY.COM
PHONE (508) 548-9607

CONDUIT LOCATIONS




POLE# _____

Qty# _____




POLE# _____

Qty# _____



POLE# _____

Qty# _____




POLE# _____

Qty# _____

NOTES:

- 1.) CONTRACTOR TO SUPPLY ELECTRICAL CONDUITS, GROUNDING WIRES, BOLT PATTERNS, ANCHOR BOLTS, NUTS & WASHERS.
- 2.) CONTRACTOR TO INDICATE CONDUIT LOCATIONS & QUANTITIES.

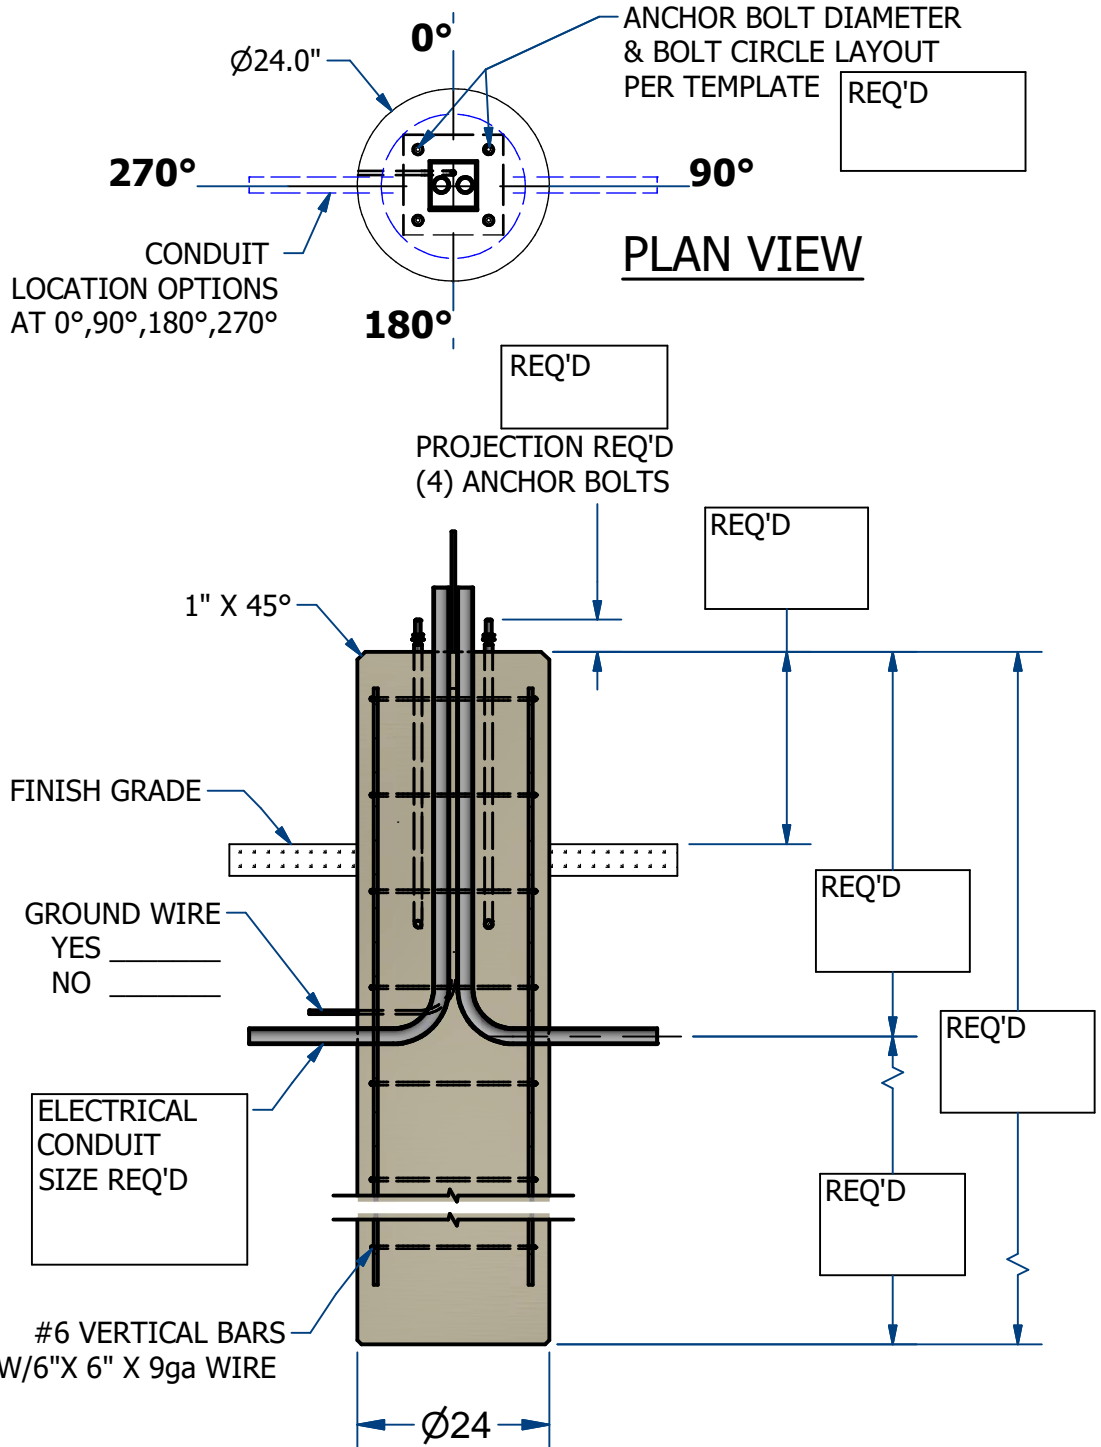

Contractor
Signature: _____

S.O.# _____

Customer
Signature: _____

NAME: LIGHT POLE BASE ASSEMBLY, 24" DIA

ITEM# LPB24

Concrete Minimum Strength: 5,000 p.s.i. at 28 days
Steel Reinforcement: ASTM A615, Grade 60

WEIGHT 475 PVF

CH

DATE: 10-2-21